


drop-down security bollards

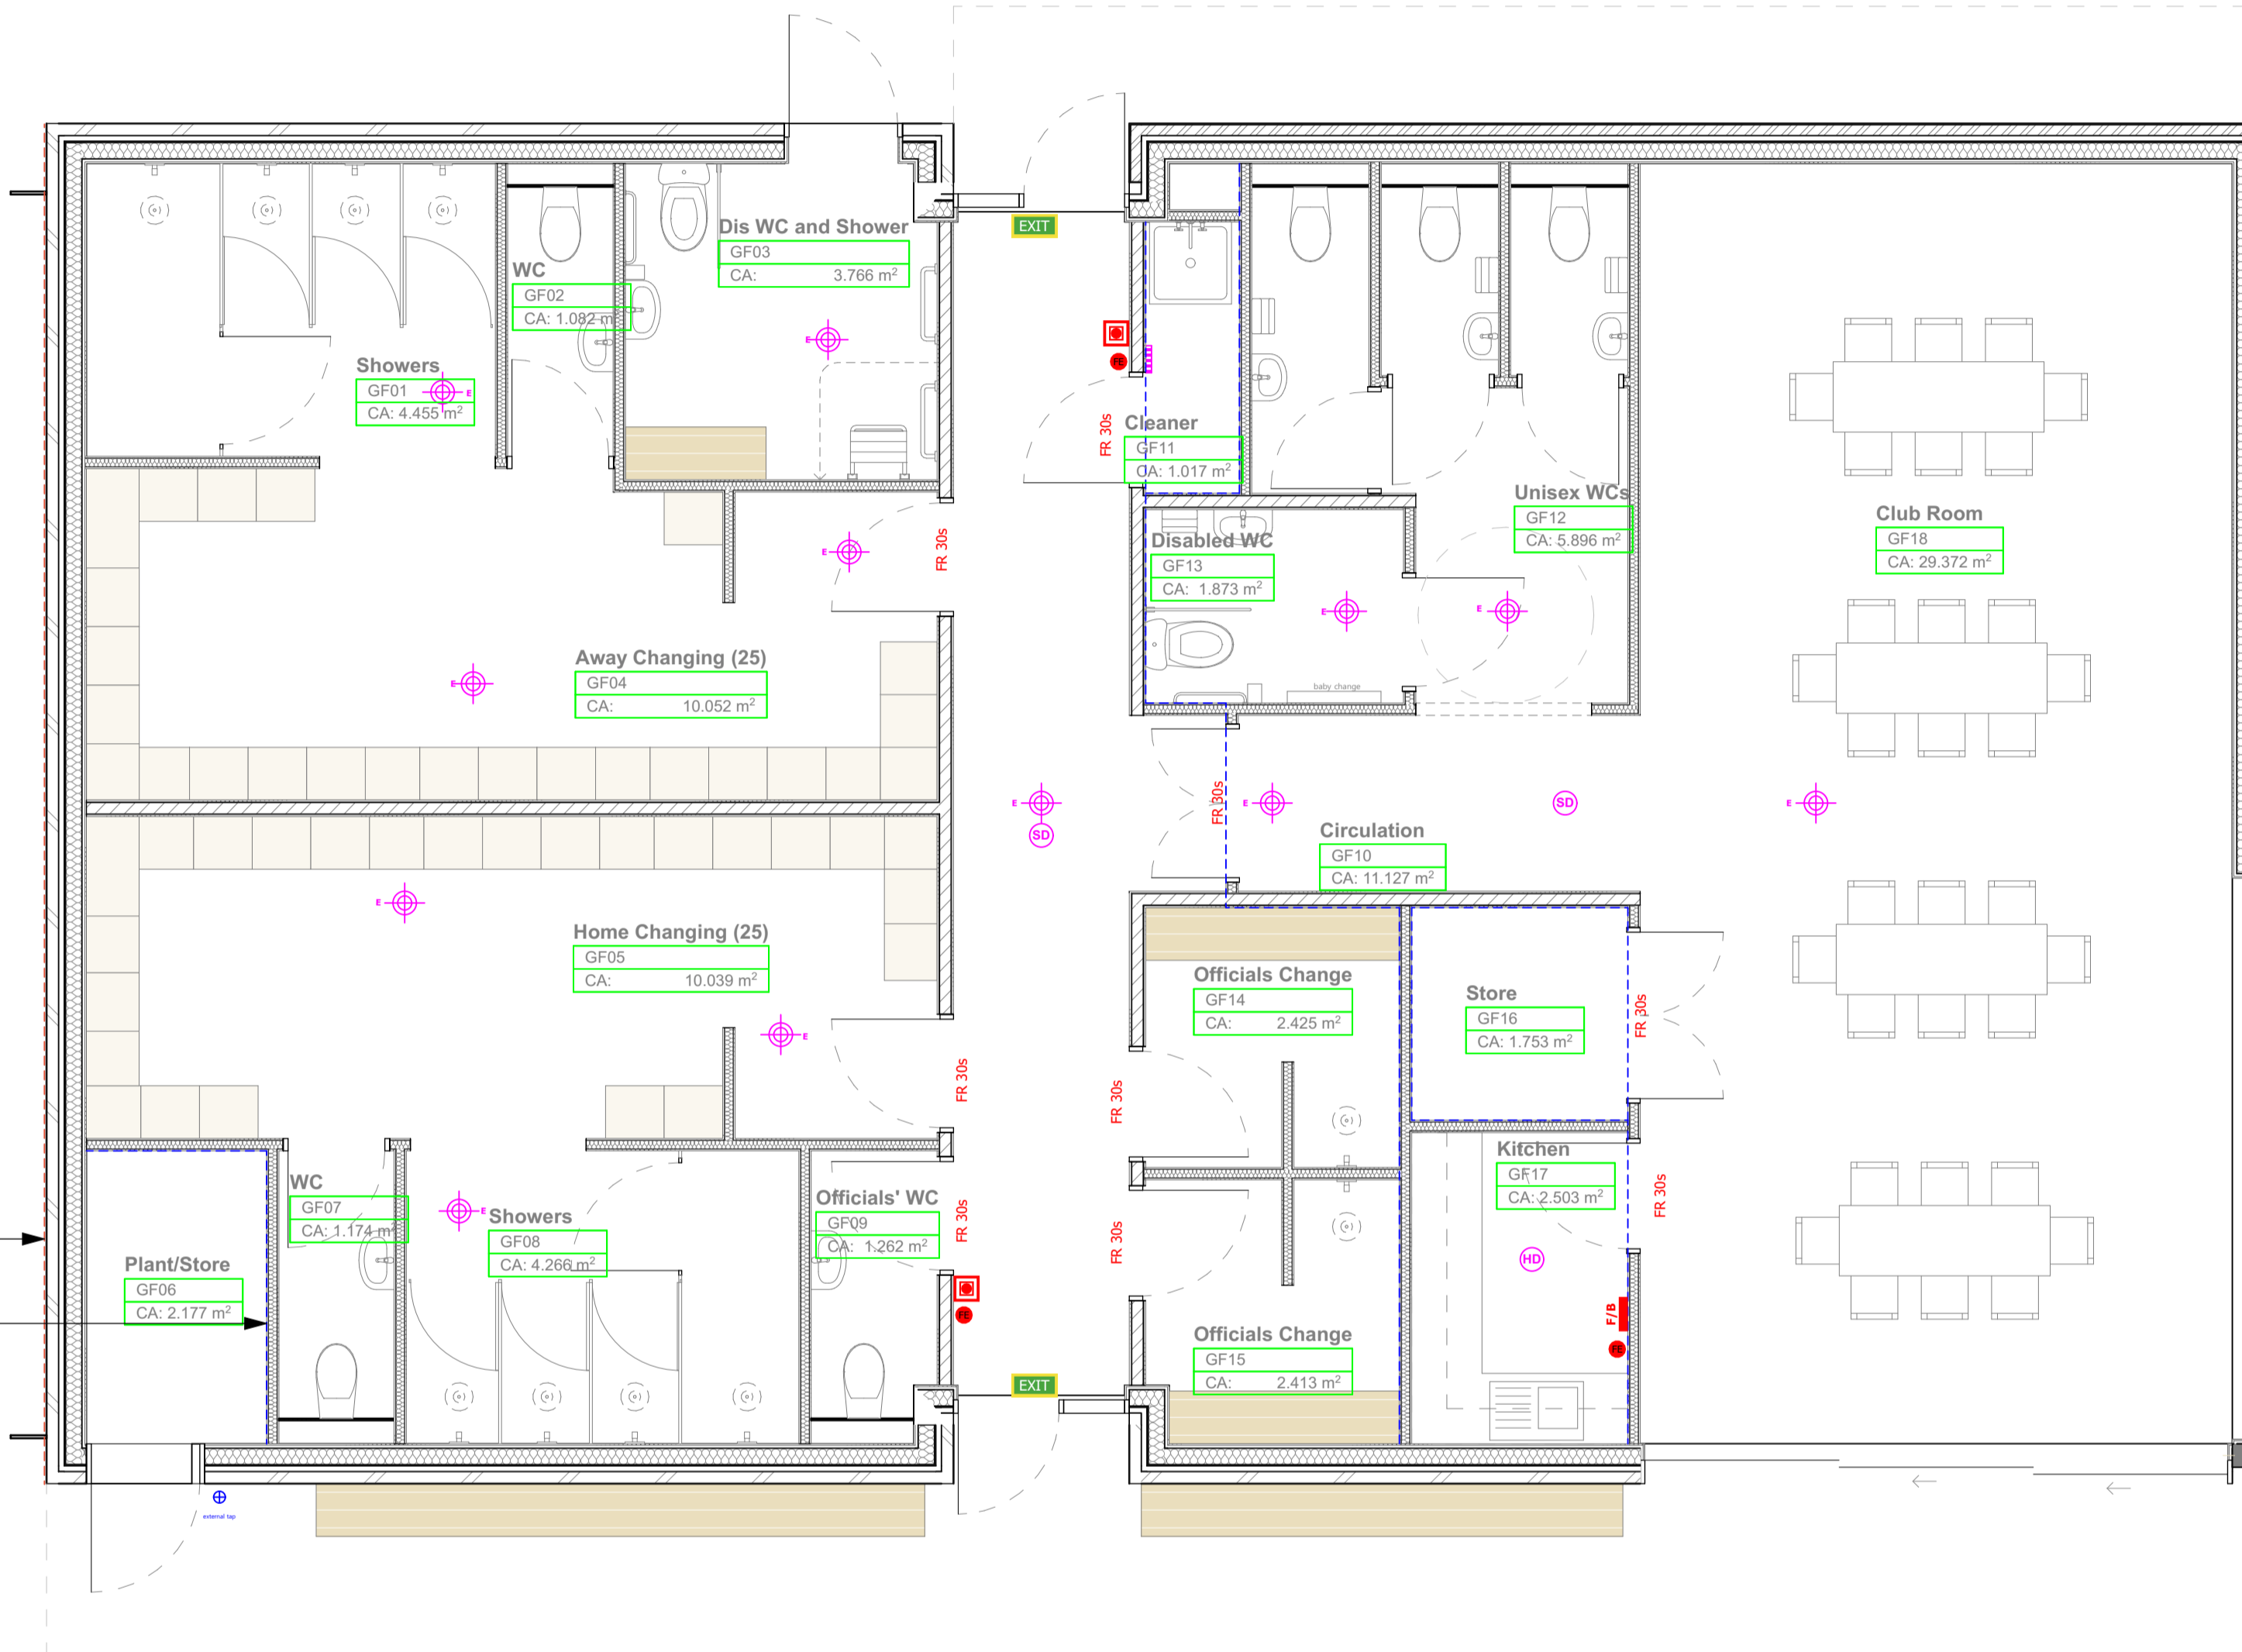


Over one metre from boundary requires a 1 hour compartment wall.

30 minute fire compartmentation.

**FIRE ARRANGEMENT KEY:**

- FR 30s Fire doors (30 min)
- FR 60 Fire doors (60 min)
- Exit arrow
- EXIT Exit signs
- EXIT Illuminated exit signs
- Break glass unit
- Fire extinguisher
- Alarm sounder
- Fire blanket
- Emergency lights
- Smoke detector
- Door push button
- Access Panel
- Alarm Panel
- Emergency Light Key Test Switch
- - - 30 minute fire compartmentation
- - - 1hr compartment wall

Proposed Ground Floor Plan  
1:50

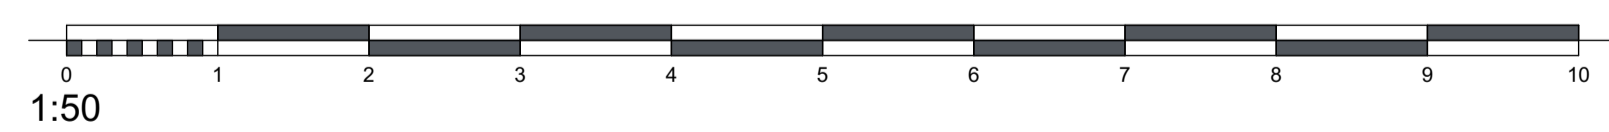

**Disclaimer:**

This drawing is subject to copyright ©, and is the property of AT Architects Limited and must not be copied in whole or in part without their written permission. This drawing should be read in conjunction with all the appropriate consultants design drawings, together with any other AT Architects Limited drawings and the appropriate specification as issued. No liability will be accepted for any amendments made to this drawing by third parties.

This drawing must not be scaled. The contractor is to report all dimensional discrepancies, errors or omissions to AT Architects Limited prior to commencing construction work. The Contractor should also check and verify all building levels, site positioning, services, sewers, drains etc. prior to commencing any works, and notify AT Architects Limited of any discrepancies or inaccuracies accordingly.

Checked by:

EW

Revisions:

Layout	Change Name	Issue Date
		27/05/2021

RevID	Issue Name	Issue Date	Issued By
01	Building Regs 01	27/05/2021	MarkBranch

ArchCAD

Project:  
Proposed Pavilion  
Bishop's Itchington Sports  
Pavilion  
Chapel Street  
Bishop's Itchington

Client:  
Bishop's Itchington Parish  
Council

Drawing Title:  
Proposed Fire Arrangement  
Plan

Date:  
27/05/2021

Purpose of Issue:  
Building Control

Drawn by: MLB, KK:50	Scale: A1	Size: A1
Drawing No: 1485-0609-01	Rev:	



Building Control